
Block 2b
Food Water
Damaging Energy

Praxis für Naturheilverfahren und Gesprächstherapie (HPG)

Dr. rer. nat. Ursula Schornstein (HBB)

Apothekerin und Heilpraktikerin

Daring 7, D-83410 Laufen

T: +49 8682 956970

F: +49 8682 956971

dr.schornstein@gmail.com

www.dr-schornstein.de

und

IBIT (Institut für Bioenergetische u. Informatrische Therapieforschung)

Dr. med. Hegall Vollert

Professor honorario de la Universidad del Golfo

Hinter der Schanz 2, D-78315 Radolfzell

T: +49 7732 258419

F: +49 7732 258421

hegall.vollert@gmail.com

ibit.gmbh

This is what we found in our investigations:

Introduction

In our first expert opinion of May 2013 we were able to prove for the first time the type of radiation that leads to the changes in blood count caused by the so-called "electrosmog" described there. It is not - even if the name suggests it - the electromagnetic waves, but the scalar waves which are branched off from them.

In the meantime, dozens of other patients have been tested in a standardized way, who without a single exception showed the described reactions - both regarding the "money roll" of the erythrocytes and the immediate remission by bion-pads®. Wearing the bion-pads during the telephone call does not lead to a money roll.

While the remission of money roll formation in block 1 was 100% by a small, specially-informed silicone pad worn on or close to the body, the aim now is to determine whether a short run through a tap adapter produces the same or similar effects when bion-tec know-how is installed in the adapter.

The company Lucky Water in Espelkamp distributes water tap and water pipe adapters with a patented inner part, which influences the flowing water by turning it clockwise. The crystalline transformation of the calcium particles and the associated solubility is recorded in an enclosed expert report. The lime finds hardly any adhesion in pipes and sieves.

However, in investigations at the Institute for Bioenergetic and Informational Therapy Research (IBIT), this patent had no influence on the change in blood count, what is meant is the dissolution of "money rolls".

In the free chambers of a washbasin adapter, the above-mentioned company was able to insert 0.06 g of specially bion-tec-informed standardised quartz powder in a watertight manner. Now it was to be determined whether the "money roll" formation, which basically occurred in all persons tested so far after a 6-minute telephone call by mobile phone or cordless phone, can be influenced by drinking 100 ml of the water that has flowed through the washstand adapter after the telephone call.

The following questions arose:

- Is the amount of 0.06 g of the bion-tec-informed quartz in the adapter sufficient?
- Is the flow time of the water to be informed sufficient?
- Is the temperature of the water important?

Procedure

Tested were 7 persons between 11 and 73 years (8.-11.09.2014). 6 subjects initially showed normal behaviour (relaxed and mobile) of the red blood cells. One of the test persons had eaten heated food (bread) about 1 hour before. As expected, we already found a money roll in her. We tested her and 2 other people for blood count behaviour after eating heated food. A further report on this will be prepared at a later date.

1.note:

Even after the consumption of heated food, the erythrocytes always form money rolls, which can last for hours. This is why conventional medicine does not generally regard the formation of money rolls as pathological. We wonder why then remissions in severe diseases (arteriosclerosis, cancer, rheumatism, bronchial asthma, etc.) are mainly caused by vegan raw food (Dr. Brian Clement: "WunderLebensMittel", Hippocrates Health Institute; see also China Study). After the consumption of (vegan) raw food - the amount does not matter - the red blood cells never get a money roll!

2.note:

The "money rolls" are also formed in cases of poisoning, serious infections and serious chronic diseases. This leads to:

- Reduction of the flow velocity (under the microscope)
- low oxygen transport through partial covering of the surfaces of the erythrocytes
- delayed passage through the capillaries - start or maintenance of severe diseases

Procedure

The blood was taken from a fingertip. The first droplet is dabbed off and the second is taken with a cover plate and immediately placed on a slide. Important: The blood droplet must only come into contact with air for as short a time as possible; otherwise the slide will be covered with a roll of money. (Besides, the flow properties under sight are also impaired).

After the evaluation by means of a dark field microscope and image documentation, the test persons telephoned with a mobile or cordless phone for 6 minutes. Immediately afterwards a new blood sample was taken, as before. Immediately afterwards, a glass of water (approx. 100 ml) was drunk, which came directly from the water pipe with the Lucky Water vortex attachment, and ½ another drop of blood was taken up to 1 minute later.

Die durch künstliche Emission erzeugten Skalarwellen sind monopolen Ursprungs und nicht logarithmisch, sondern linear fraktioniert. Beide Eigenschaften harmonieren nicht mit den Raumwellen (kosmischen Wellen), wodurch es nach Ansicht des Autors Vollert zu mannigfachen biologischen (medizinischen) Schäden kommt, die durch tausende „Elektrosmog“-Studien belegt sind. Anders ausgedrückt: Eine **Disharmonie** beider Skalarwellensysteme führt zu Erkrankungen (s. a. Nachsatz).

Result

The water flowing through had absorbed the information of the 0.06 g quartz content in a fraction of a second and transmitted it to the entire bodies of the test persons within the measuring time between the second and third blood sampling. No more money rolls were visible in all test persons. The images resembled those of the initial values. By the way, the flow properties were even slightly improved compared to the initial findings. It did not matter whether cool or room-warm water was drunk.


To the biophysics

The harmony of all functioning biological systems is created by the energy of space. According to the author Vollert, these are three-dimensional, i.e. spatial scalar waves. They are tuned among each other in a natural logarithmic fractal way, namely as dipolar standing waves (see also postscript).

Conclusion:


The findings result from the simultaneity of dipolar scalar waves everywhere = infinite velocity. For this purpose 0.06 g = 60 mg of bion-tec-informed quartz powder is completely sufficient. The prophylactic significance should not be insignificant with continuous consumption. Freely moving blood cells should also be an indispensable requirement for therapeutic purposes!

Finally, we show three blood images of one person, which are representative of all the test persons examined.

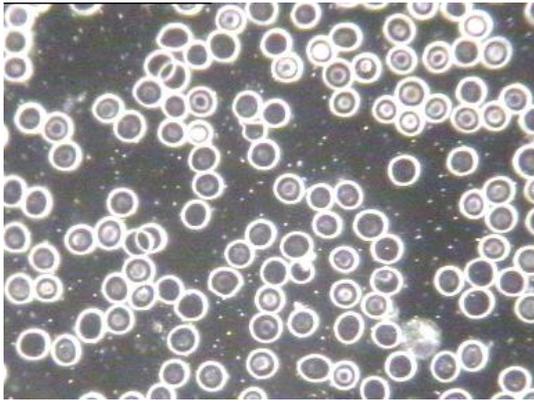


1st picture

Initial blood count before mobile phone use. Fasting or at least 8 hours before no heated food: Normal red blood cell distribution.

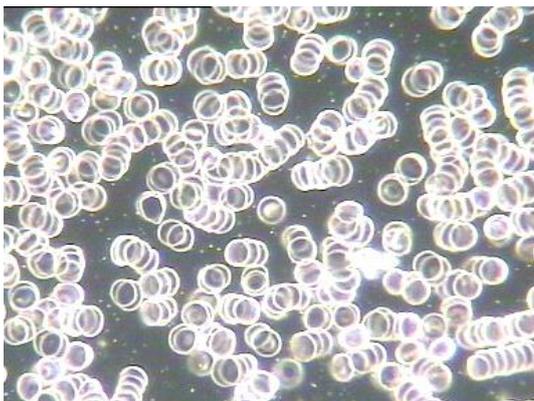

2. picture

6 minutes after mobile or cordless phone call: Typical money roll formation of the erythrocytes.

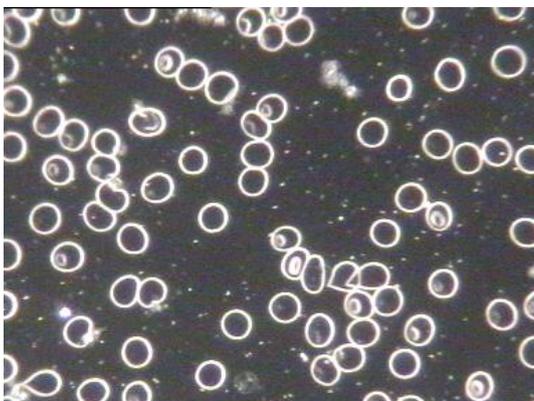

3. picture

0.5 to 1 minute after drinking approx. 100 ml of bion-tec-informed water (see text): Normal distribution of erythrocytes.

Postscript

Our many years of research and expert opinions imperatively demand an adaptation to modern biophysics. Traditional definitions of disease and life in biology and medicine are standing still and are

insufficient for our findings. Many years of research have resulted in different definitions of life and illness.

Every life is the resonant expression of biophysical information patterns from logarithmically scale invariant fractals of vacuum compression energy (space energy), or proton resonance energy.

Dr. med. Hegall Vollert

Any disorder or disease is the dissonant intervention of harmful waves (linear, scale-variant wave patterns) on information from certain biophysical logarithmic scale-invariant fractals of vacuum compression energy or proton resonance energy.

Dr. med. Hegall Vollert